

Number	22-004728-PR06 (NW-A01-06-en-01)
Owner	Kompen PVC Yapi ve Insaat Malzemeleri Sanayi Ticaret A.S. Konya Afyon Karayolu 45. Km. Ladik Mevkii 42435 Sarayönü - Konya Türkiye
Product	Double leaf sliding window
Designation	kom 1800 HYPERLINE window system
Details	Overall dimensions (W x H) 1500 mm x 1500 mm; Material Polyvinylchloride unplasticized (PVC-U); Projected width from - to 76 mm - 141 mm; Structural depth 162 mm; Thickness of infill 44 mm; Edge cover of infill 18.5 mm; Reinforcement material Steel, galvanized; Casement; Designation 1804; Reinforcement: Cross section (W x H x T) 35 mm x 45 mm x 0.8 mm; Additional profile: Designation 1817; Frame; Designation 1801; Reinforcement: Cross section (W x H x T) 19 mm x 45 mm x 0.8 mm; Additional profile: Designation 1818 / 1826; Mullion; Designation 1803; Reinforcement: Cross section (W x H x T) 31.5 mm x 44 mm x 0.8mm; Glazing; Configuration in mm 4/14/6/14/6; Dimensions (W X H) 610 mm x 1348 mm / 559 mm x 1218 mm; Thermal transmittance Ug in W/(m²K) 0.6 (as specified by client); Spacer; Type rep. metal spacer acc. to EN ISO 10077-2

Special features

## Result

Calculation of thermal transmittance according to EN ISO 10077-1:2017-07, corrected version 2020-02



$$U_W = 1.1 \text{ W/(m}^2\text{K)}$$

ift Rosenheim

21.07.2023



Konrad Huber, Dipl.-Ing. (FH)  
Head of Testing Department  
Building Physics



Till Stübgen, Dipl.-Ing. (FH)  
Operating Testing Officer  
Building Physics

## Basis \*)


EN ISO 10077-1:2017-07, corrected version 2020-02

\*) and corresponding national versions (e.g. DIN EN)

Test report: 22-004728-PR06 (PB-A01-06-en-01)

## Representation

Cross section at top

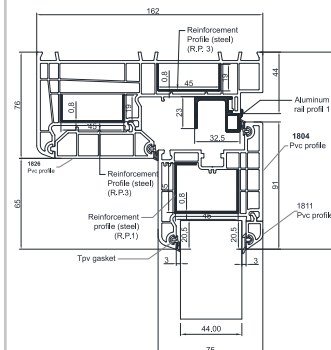

## Instructions for use

The results obtained can be used as evidence in accordance with the above basis.

## Validity

There is no time limit. When using this document the up-to-dateness of above basis and the conformity of the product have to be observed.

The data and detailed results given relate solely to the tested/described specimen.

This test does not allow any statement to be made on further characteristics of the present structure regarding performance and quality, in particular the effects of weathering and ageing.

## Notes on publication

The ift-Guidance Sheet "Conditions and Guidance for the Use of ift Test Documents" applies.

## Identity-Check



[www.ift-rosenheim.de/ift-geprueft](http://www.ift-rosenheim.de/ift-geprueft)  
ID: F6D-02045